




TYPICAL PITLESS BOOSTER INSTALLATION

PITLESS BOOSTER UNITS FOR SUBMERSIBLE PUMPS
5" through 36" TANK SIZES

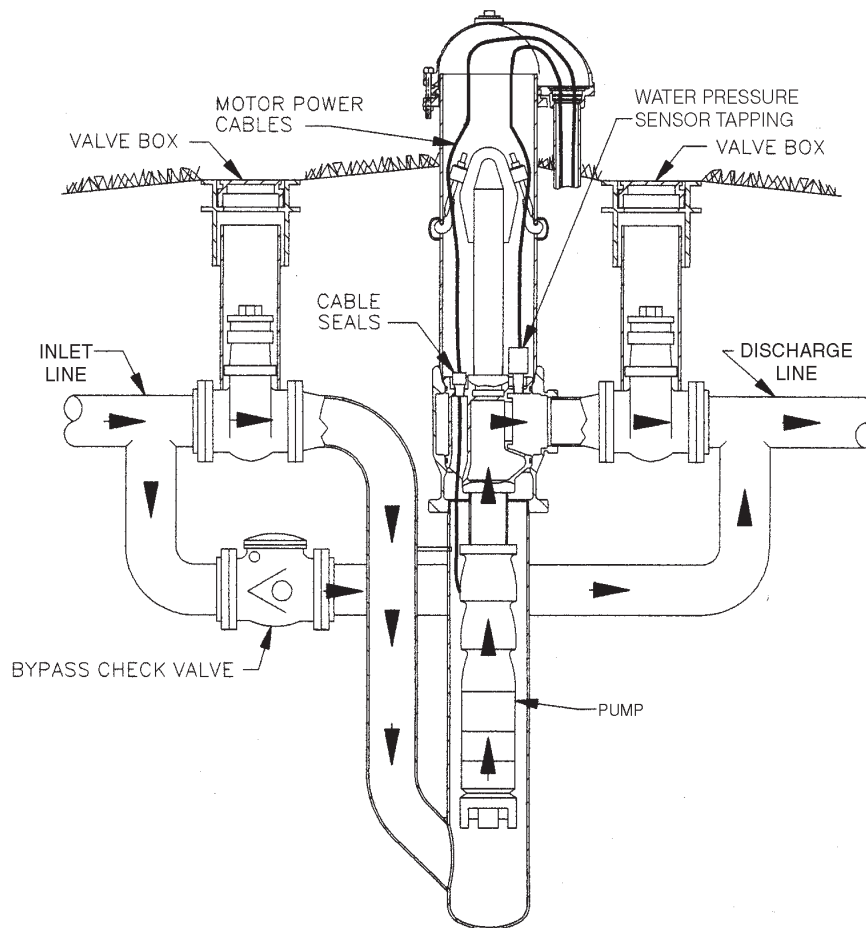

OM-5013(05-08)

Baker Manufacturing Co., LLC/Monitor Division • Evansville, WI 53536
Phone: 800-356-5130 • Fax: 608-882-3777 • Website: bakermonitor.com